


BAGNO + ANTI BAGNO
 SUP. LOCALE=(1,66X2,32)+(1,66X1,10)=
MQ 5,68
 H 330
 verifica R.A.I.:
 SUP.AL MIN.=5,68 / 8 = 0,71 mq
 SUP.AL = (0,50X1,50) = **0,75 MQ** > 0,71 MQ

DISIMPEGNO
 SUP. LOCALE=(1,26X9,69)=
MQ 12,21
 H 330
 LOCALE SENZA PERMANENZA DI PERSONE
 NON SOGGETTO A VERIFICA RAI

UFFICIO 1
 SUP. LOCALE=(4,27X3,39)+(2,10X1,93)2=
MQ 16,51
 H 330
 verifica R.A.I.:
 SUP.AL MIN.=16,51 / 8 = 2,06 mq
 SUP.AL = (0,90X2,40) = **2,16 MQ** > 2,06 MQ

DISIMPEGNO
 SUP. LOCALE=(3,19X2,94)=
MQ 9,38
 H 330
 LOCALE SENZA PERMANENZA DI PERSONE
 NON SOGGETTO A VERIFICA RAI

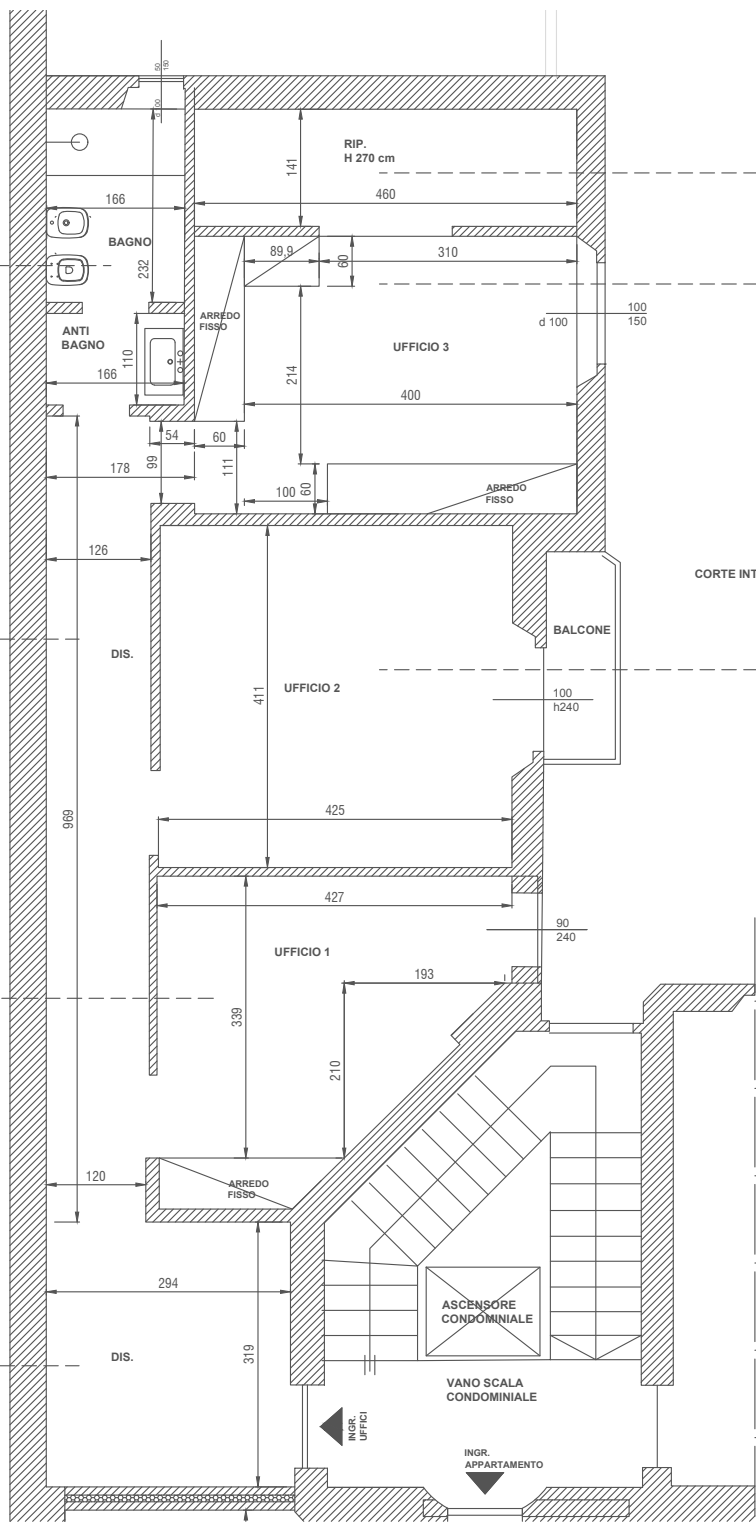

RIPOSTIGLIO
 SUP. LOCALE=(4,60X1,41)=
MQ 6,48
 H 330
 LOCALE CON ASPIRAZIONE FORZATA (12 VOL/ORA
 art.90 comma 5 REG.EDIL.)

UFFICIO 3
 SUP.
 LOCALE=(2,14X4,00)+(3,10X0,60)+(0,60X1,11)+(0,60X1,00)=
MQ 11,69
 H 330
 verifica R.A.I.:
 SUP.AL MIN.=11,69 / 8 = 1,46 mq
 SUP.AL = (1,00X1,50) = **1,50 MQ** > 1,46 MQ

UFFICIO 2
 SUP. LOCALE=(4,11X4,25)=
MQ 17,47
 H 330
 verifica R.A.I.:
 SUP.AL MIN.=17,47 / 8 = 2,18 mq
 SUP.AL = (1,00X2,40) = **2,40 MQ** > 2,18 MQ